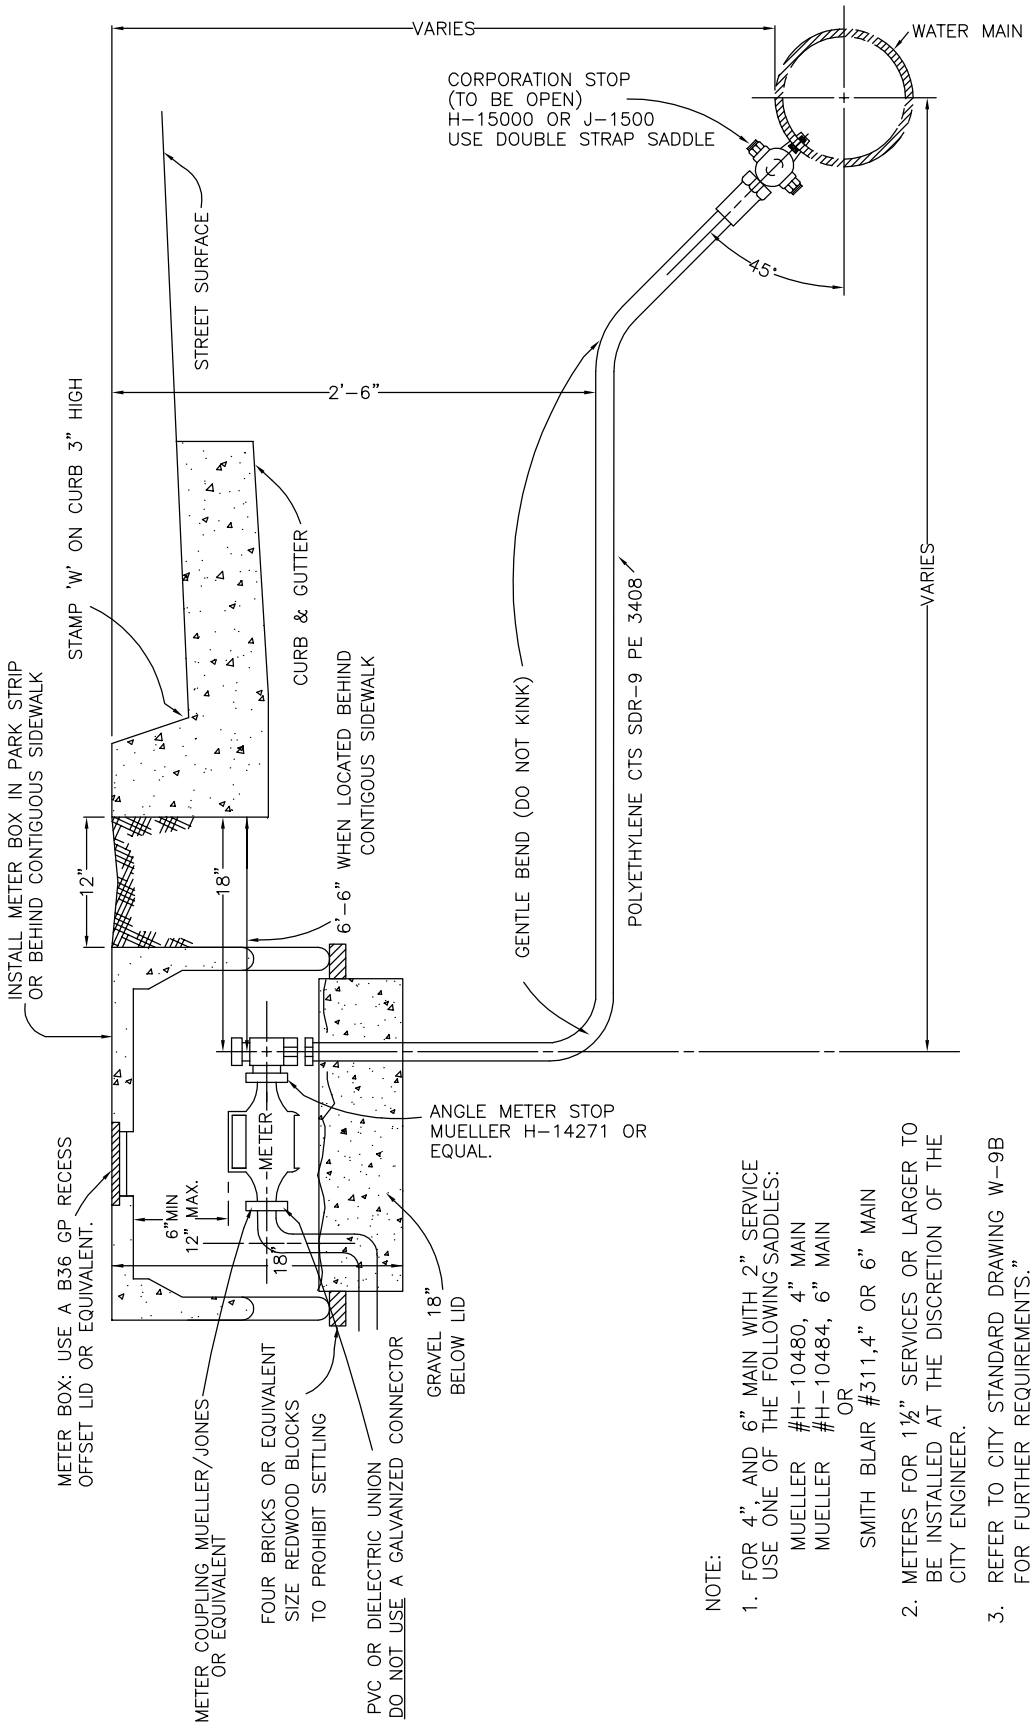

NOTE:

1. FOR 4", AND 6" MAIN WITH 2" SERVICE USE ONE OF THE FOLLOWING SADDLES:
   MUELLER #H-10480, 4" MAIN
   MUELLER #H-10484, 6" MAIN
   OR
   SMITH BLAIR #311,4" OR 6" MAIN
2. METERS FOR 1½" SERVICES OR LARGER TO BE INSTALLED AT THE DISCRETION OF THE CITY ENGINEER.
3. REFER TO CITY STANDARD DRAWING W-9B FOR FURTHER REQUIREMENTS."
4. POLYETHYLENE PIPE SHALL USE CAMPAK COMPRESSION-TYPE JOINTS WITH STAINLESS STEEL INSERT

1 1/4", 1 1/2", 2" SERVICE CONNECTION & METER BOX INSTALLATION

REF. & REV.
MARCH 2005
AUG. 2008
SEPT. 2009
FEB. 2016

CITY OF MADERA

W-10